

## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

October 9, 2015

Attention: Mrs. Fischer

Subject: September 2015 Monthly Report

On the billing cycles ending on the 25th of September 41,935,000 gallons of water were used by our consumers, an average of 1,270,000 gallons was used per day.

On September 8, 2015 the Water Plant filter #1 was turning off and on erratically due to the Supervisory Control and Data Acquisition (SCADA) system malfunction. The issue was temporary resolved by bypassing a level sensor. We acquired the services of ESG to help us resolve the problem. Alex from ESG found one of the output Programmable Logic Controller (PLC) modules was defective which was sending an incorrect signal to water filter causing it to turn off and on. This PLC module was replaced and filter is now working appropriately. There were no violations or water quality issues because of this incident.


On September 24, 2015 operator notice that no chlorine was being produce by the hypochlorite system. The operator trouble shooted the equipment and found the problem was the level sensor on one of the chlorine cells. This level sensor protects the cell from burning up in case there is was no water in the cells. The level sensor was replaced and is now working properly. There were no violations or water quality issues because of this incident.

If you have any questions, please contact me at (760) 427-4685

Sincerely,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

October 9, 2015

Attention: Mrs. Fischer  
General Manager

Subject: Water Distribution Report September 2015

A) Water breaks (0)

B) Service Leak (1)  
1. 15 Mallard Ct.

C) Work orders ( 74 )

Sincerely,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District




**HEBER PUBLIC UTILITY DISTRICT**  
**Water Treatment Plant and Billing Report**  
**Billing Period : August 24, 2015 thru September 25, 2015**

<i>Mth. &amp; Yr.</i>	<i>Water</i>		<i>HPUD Offices/Parks</i>	<i>Difference Water</i>	<i>Sewer</i>	<i>Invoiced</i>	<i>Invoiced</i>	<i>Invoiced</i>
	<i>Gals. Produced</i>	<i>Gals. Invoiced</i>	<i>Gallons not invoiced</i>	<i>Not accounted</i>	<i>Influent</i>	<i>Water</i>	<i>Sewer</i>	<i>Trash</i>
Sep-14	39,630,000	25,830,983	1,043,570	12,755,547	18,088,000	\$ 119,731.66	\$ 98,936.31	\$ 40,383.04
Oct-14	34,674,000	24,238,933	673,950	10,367,672	19,563,000	\$ 117,929.12	\$ 98,838.72	\$ 40,160.35
Nov-14	34,351,000	21,407,407	601,490	12,342,103	21,559,000	\$ 113,870.72	\$ 99,037.78	\$ 40,130.68
Dec-14	25,194,000	21,426,940	1,450,380	2,316,680	19,786,000	\$ 115,808.39	\$ 99,067.67	\$ 40,131.37
Jan-15	26,886,000	17,282,967	432,630	9,170,403	20,754,000	\$ 109,681.46	\$ 99,037.87	\$ 40,138.38
Feb-15	27,013,000	16,586,459	411,800	10,014,741	20,458,000	\$ 108,239.11	\$ 99,077.59	\$ 40,052.05
Mar-15	27,543,000	18,024,513	402,780 high due to sewer plant	9,115,707	19,181,000	\$ 110,957.74	\$ 99,131.35	\$ 40,098.74
Apr-15	35,351,000	33,459,294	10,188,590	1,891,706	19,371,000	\$ 119,590.57	\$ 99,077.40	\$ 40,060.27
May-15	36,450,000	25,680,055	933,970	9,835,975	19,316,000	\$ 121,795.38	\$ 98,988.32	\$ 40,008.93
Jun-15	42,038,000	28,045,986	938,970	13,053,044	18,520,000	\$ 127,203.74	\$ 98,986.67	\$ 40,101.70
Jul-15	38,541,000	27,999,153	748,100	9,793,747	18,391,000	\$ 126,237.41	\$ 98,850.73	\$ 39,890.54
Aug-15	41,282,000	29,542,948	1,594,840	11,739,052	17,517,000	\$ 127,873.59	\$ 99,260.15	\$ 40,714.90
<b><u>Sep-15</u></b>	<b><u>41,935,000</u></b>	<b><u>31,632,737</u></b>	<b><u>1,166,260</u></b>	<b><u>9,136,003</u></b>	<b><u>19,303,000</u></b>	<b><u>\$ 131,788.83</u></b>	<b><u>\$ 99,236.82</u></b>	<b><u>\$ 40,793.96</u></b>


Totals includes billing for final accounts

To the best of my knowledge, the information is true and correct.

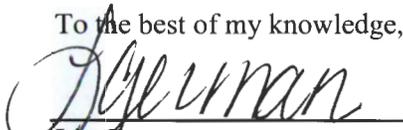
  
 Liz German  
 Office Senior Clerk

10/8/2015  
 Date

### Water Produced by Month 2014-15

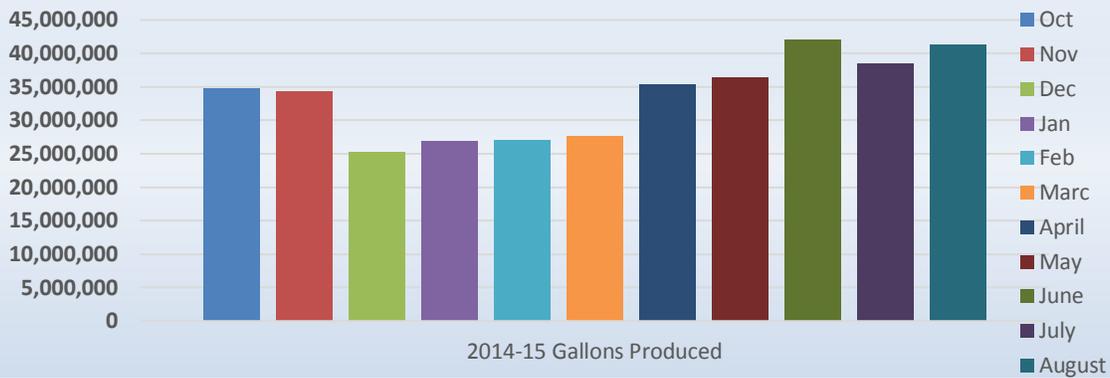


### Sewer Collection by Month 2014-15

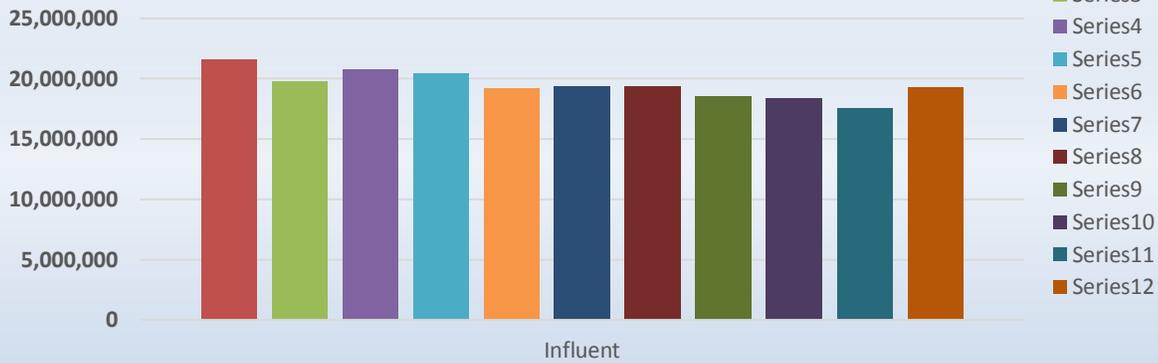

### Water Production by Month Two Year Comparison





## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

October 8, 2015

Attention: Laura Fischer  
General Manager

**SUBJECT: Heber W.W.T.P. Operations from August 24, 2015 to  
September 25, 2015**

- A. Major violations (NONE)
- B. Minor violations (NONE)
- C. Major sewer spills (NONE)
- D. Main sewer Plugs: (NONE)
- E. UV System: Operating fine.
  
- F. From August 24, 2015 through September 25, 2015:  
Heber Wastewater Plant received and treated 19.303 MG.
  
- G. HPUD did not exceed the daily maximum flow (1.2 MGD) as  
of September 25, 2015.

Sincerely,

A handwritten signature in blue ink, appearing to read "E. Gonzalez", is written over a horizontal line.

Edoardo S. Gonzalez  
Wastewater Plant Operator