



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

September 13, 2017

Attention: Mrs. Fischer

Subject: August 2017 Monthly Report

On the billing cycles ending on the 23rd of August 41,160,000 gallons of water were used by our consumers, an average of 1,327,000 gallons was used per day.

On August 9, 2017 after new filter media was poured into filter #2 and a backwash was initiated, it was noticed that it had a few sink holes which indicated media loss through the filter underdrains. Pacific Hydrotech removed the media in the affected area and made the necessary repairs. Filter #2 is now in good working condition.

On August 15, 2017 Pacific Hydrotech completed work on pond #1 outlet structure and piping. Pond #1 has been filled up and is in operation, all three ponds are full. Pond #1 is being dosed with ferric sulfate at the static mixer station which will aid in the settling process by settling out the organics and thus reducing Trihalomethanes further down in the water treatment process.

If you have any questions, please contact me at (760) 427-4685

Sincerely,

A handwritten signature in blue ink that reads "Francisco Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

September 13, 2017

Attention: Mrs. Fischer  
General Manager

Subject: Water Distribution Report August 2017


- A) Water breaks (1)
  - 1. Alley of 15 Dove Court
- B) Service Leak (0)
- C) Work orders (83)

Sincerely,


A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District


### Water Produced by Month September 2016 - August 2017

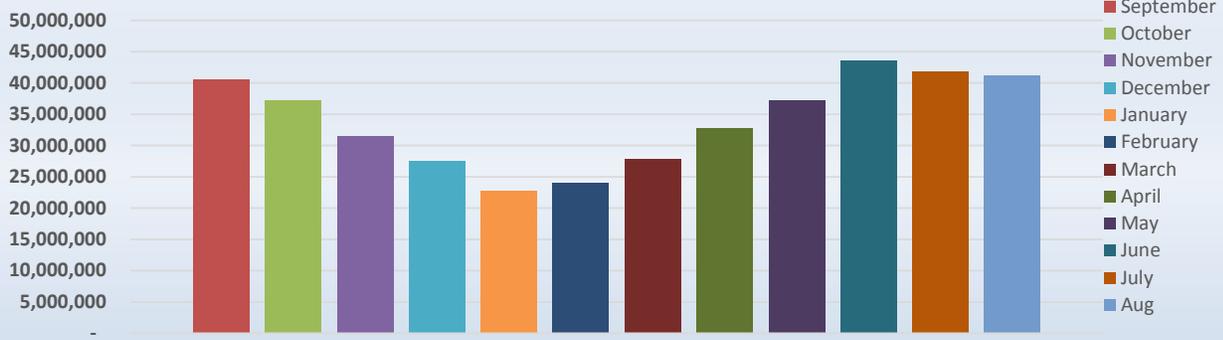

### Sewer Influent by Month Sept. 2016 - Aug 2017

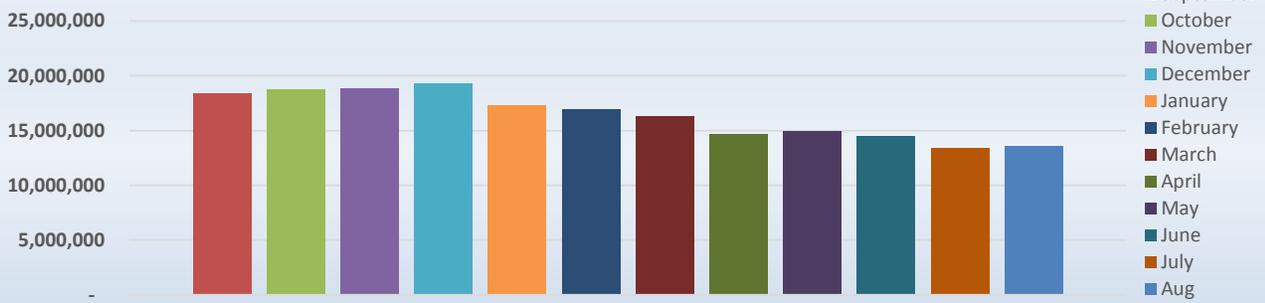

### Water Production by Month Two Year Comparison

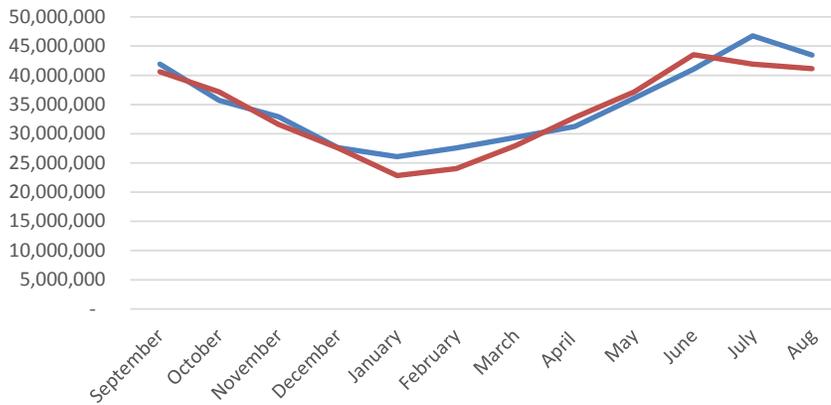




**HEBER PUBLIC UTILITY DISTRICT**  
**Water Treatment Plant and Billing Report**  
**Billing Period : July 23, 2017 thru August 23, 2017**


Mth. & Yr.	Water		HPUD Offices/Parks	Difference Water	Sewer	Invoiced	Invoiced	Invoiced
	Gals. Produced	Gals. Invoiced	Gallons not invoiced	Not accounted	Influent	Water	Sewer	Trash
Aug-16	43,487,000	37,639,673	2,245,622	3,601,705	17,427,000	\$ 131,341.94	\$ 98,999.03	\$ 41,241.49
Sep-16	40,587,000	30,081,634	1,257,491	9,247,875	18,403,000	\$ 131,264.57	\$ 99,491.68	\$ 41,394.45
Oct-16	37,159,000	26,121,181	2,052,638	8,985,181	18,741,000	\$ 120,645.10	\$ 99,272.33	\$ 41,310.60
Nov-16	31,567,000	23,421,593	1,406,582	6,738,825	18,835,000	\$ 119,389.36	\$ 99,269.30	\$ 41,338.80
Dec-16	27,591,000	19,384,722	1,344,947	6,861,331	19,332,000	\$ 112,768.91	\$ 99,395.38	\$ 41,406.22
Jan-17	22,833,000	14,942,776	686,130	7,204,094	17,310,000	\$ 109,302.03	\$ 99,782.01	\$ 41,439.13
Feb-17	24,005,000	16,702,805	795,692	7,302,195	16,965,000	\$ 109,810.20	\$ 99,680.10	\$ 41,251.82
Mar-17	27,942,000	19,388,577	944,349	7,609,074	16,325,000	\$ 113,162.10	\$ 99,805.52	\$ 41,293.75
Apr-17	32,791,000	24,643,923	1,053,561	7,093,516	14,616,000	\$ 119,605.72	\$ 99,800.29	\$ 41,292.49
May-17	37,175,000	26,263,237	1,364,143	9,547,620	14,928,000	\$ 122,488.65	\$ 100,029.46	\$ 41,402.03
Jun-17	43,530,000	31,613,609	1,439,099	11,773,292	14,481,000	\$ 133,896.35	\$ 99,862.17	\$ 41,345.46
Jul-17	41,907,000	32,289,352	1,497,306	8,120,342	13,402,000	\$ 140,711.94	\$ 97,991.51	\$ 41,664.23
<b>Aug-17</b>	<b>41,160,000</b>	<b>31,401,126</b>	<b>1,659,102</b>	<b>8,099,772</b>	<b>13,570,000</b>	<b>\$ 137,488.33</b>	<b>\$ 98,196.57</b>	<b>\$ 41,576.85</b>

Totals includes billing for final accounts

To the best of my knowledge, the information is true and correct.

  
 Liz German  
 Office Senior Clerk

9/13/2017  
 Date



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249

TEL. (760) 482-2440 • FAX (760) 353-9951

[www.heber.ca.gov](http://www.heber.ca.gov)

September 12, 2017

Attention: Laura Fischer  
General Manager

SUBJECT: Heber W.W.T.P. Operations from July 23, 2017 to August 23, 2017

- A. Major violations: (NONE)
- B. Minor violations (NONE)
- C. Major sewer spills (NONE)
- D. Main sewer Plugs: (NONE)
- E. UV System: Operating fine. Self Cleaning. No Maintenance.
- F. Vactor Truck: Not used during this time cycle.

G. From July 23, 2017 through August 23, 2017:  
Heber Wastewater Plant received and treated 13.570 MG.

H. HPUD did not exceed the daily maximum flow (1.2 MGD) as of  
August 23, 2017.

Sincerely,

A handwritten signature in blue ink that reads "Lucas G. Agatep".

Lucas G. Agatep  
Wastewater Plant Lead Operator

*Heber Public Utility District is an equal opportunity provider and employer*