



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

March 09, 2016

Attention: Mrs. Fischer

Subject: February 2016 Monthly Report

On the billing cycle ending on the 24<sup>th</sup> of February 28,092,000 million gallons of water were used by our consumers, an average of 878,000 thousand gallons was used per day.

On February 1, 2016 Clarifier head loss was high due to solenoid malfunction. This solenoid opens the valve which allows the blower air into the clarifier and cleans the media. The solenoid was replaced and is now working appropriately.

On February 24, 2016 a new 2000 gallon chlorine tank was installed in the hypochlorite room to replace an older tank that frequently had leaks. Both chlorine tanks are now in service.


There were no violations from either of these issues.

If you have any questions, please contact Francisco Rodriguez at (760) 427-4685

Respectfully,

A handwritten signature in blue ink, appearing to read "F. Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

March 09, 2016

Attention: Mrs. Fischer  
General Manager


Subject: Water Distribution Report February 2016

- a) Water Breaks (0)
- b) Service Leak (1)
  - 1. 1101 Hefferman Avenue
- c) Work orders ( 68 )

Sincerely,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez  
Water Distribution Chief Operator  
Heber Public Utility District



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951

March 10, 2016

Attention: Laura Fischer  
General Manager

SUBJECT: Heber W.W.T.P. Operations from January 24, 2016 to  
February 24, 2016

- A. Major violations (NONE)
- B. Minor violations (NONE)
- C. Major sewer spills (NONE)
- D. Main sewer Plugs: January 28, 2016. Alley between Main St. (Hwy 86) and 7<sup>th</sup> St. Behind Kennedy's Market.
- E. UV System: Operating fine.
- F. Vactor Truck: Operators cleaned pump stations located on 6<sup>th</sup> street and Parkyns avenue.
  
- G. From January 24, 2016 through February 24, 2016:  
Heber Wastewater Plant received and treated 21.207 MG.
  
- H. HPUD did not exceed the daily maximum flow (1.2 MGD) as of February 24, 2016.

Sincerely,

A handwritten signature in blue ink that reads "Lucas G. Agatep".

Lucas G. Agatep  
Wastewater Plant Lead Operator




**HEBER PUBLIC UTILITY DISTRICT**  
**Water Treatment Plant and Billing Report**  
**Billing Period : January 24, 2015 thru February 24, 2016**

<i>Mth. &amp; Yr.</i>	<i>Water</i>		<i>HPUD Offices/Parks</i>	<i>Difference Water</i>	<i>Sewer</i>	<i>Invoiced</i>	<i>Invoiced</i>	<i>Invoiced</i>
	<i>Gals. Produced</i>	<i>Gals. Invoiced</i>	<i>Gallons not invoiced</i>	<i>Not accounted</i>	<i>Influent</i>	<i>Water</i>	<i>Sewer</i>	<i>Trash</i>
Jan-15	26,886,000	17,282,967	432,630	9,170,403	20,754,000	\$ 109,681.46	\$ 99,037.87	\$ 40,138.38
Feb-15	27,013,000	16,586,459	411,800	10,014,741	20,458,000	\$ 108,239.11	\$ 99,077.59	\$ 40,052.05
Mar-15	27,543,000	18,024,513	402,780	9,115,707	19,181,000	\$ 110,957.74	\$ 99,131.35	\$ 40,098.74
Apr-15	35,351,000	33,459,294	10,188,590	1,891,706	19,371,000	\$ 119,590.57	\$ 99,077.40	\$ 40,060.27
May-15	36,450,000	25,680,055	933,970	9,835,975	19,316,000	\$ 121,795.38	\$ 98,988.32	\$ 40,048.93
Jun-15	42,038,000	28,045,986	938,970	13,053,044	18,520,000	\$ 127,203.74	\$ 98,986.67	\$ 40,141.70
Jul-15	38,541,000	27,999,153	748,100	9,793,747	18,391,000	\$ 126,237.41	\$ 98,850.73	\$ 39,840.54
Aug-15	41,282,000	29,542,948	1,594,840	11,739,052	17,517,000	\$ 127,873.59	\$ 99,260.15	\$ 40,714.90
Sep-15	41,935,000	31,632,737	1,166,260	9,136,003	19,303,000	\$ 131,788.83	\$ 99,236.82	\$ 40,793.96
Oct-15	35,704,000	24,287,593	1,038,820	10,377,587	18,747,000	\$ 118,097.94	\$ 99,439.87	\$ 40,833.70
Nov-15	32,894,000	24,569,670	860,910	7,463,420	20,848,000	\$ 120,775.90	\$ 99,350.96	\$ 40,678.04
Dec-15	27,594,000	18,779,872	572,160	8,241,968	20,764,000	\$ 112,142.95	\$ 99,298.66	\$ 40,650.65
Jan-16	26,070,000	15,494,455	648,430	9,927,115	21,262,000	\$ 108,298.08	\$ 99,279.08	\$ 40,529.25
<b><u>Feb-16</u></b>	<b><u>28,092,000</u></b>	<b><u>18,993,526</u></b>	<b><u>936,501</u></b>	<b><u>8,161,973</u></b>	<b><u>21,207,000</u></b>	<b><u>\$ 111,685.78</u></b>	<b><u>\$ 99,344.04</u></b>	<b><u>\$ 40,906.15</u></b>

high due to sewer plant


Totals includes billing for final accounts

To the best of my knowledge, the information is true and correct.


  
 Liz German  
 Office Senior Clerk

3-10-16  
 Date

### Water Produced by Month 2015-16

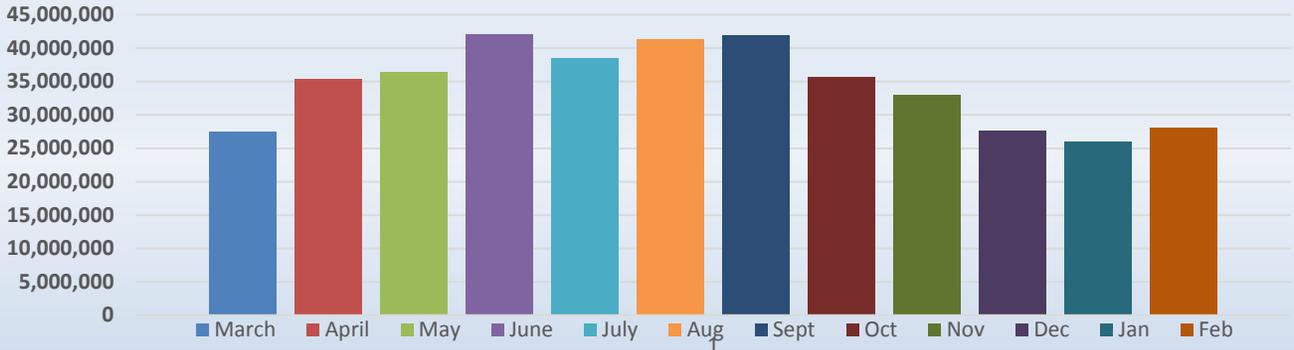

### Sewer Influent by Month 2015-16

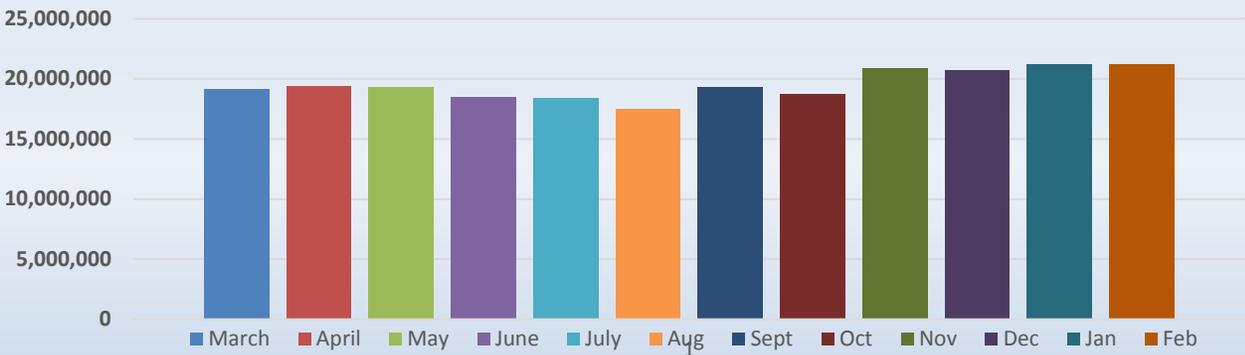

### Water Production by Month Two Year Comparison

