

Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H
Heber, CA 92249
TEL. (760) 482-2440 • FAX (760) 353-9951
www.heber.ca.gov

October 12, 2016

Attention: Mrs. Fischer

Subject: September 2016 Monthly Report

On the billing cycles ending on the 23rd of September 40,587,000 gallons of water were used by our consumers, an average of 1,309,000 gallons was used per day.


On September 1, 2016 started draining pond #2 and #3 in order for Pacific Hydrotech to install a larger diameter pipe between the ponds as part of the Water Treatment expansion project. After pond #2 dry sludge was removed and upon inspection of the liner, several small perforations were notice and marked. Currently, Pacific Hydrotech subcontractor are making the necessary liner repairs. Pond #3 is at this time being cleaned and will be inspected upon completion.

If you have any questions, please contact me at (760) 427-4685

Sincerely,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez
Chief Operator
Heber Public Utility District



Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H
Heber, CA 92249
TEL. (760) 482-2440 • FAX (760) 353-9951
www.heber.ca.gov

October 12, 2016

Attention: Mrs. Fischer
General Manager

Subject: Water Distribution Report September 2016

- A) Water breaks (1)
 - 1. 17 Dove Court

- B) Service Leak (1)
 - 1. 54 Main Street

- C) Work orders (56)

Sincerely,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez
Chief Operator
Heber Public Utility District




HEBER PUBLIC UTILITY DISTRICT
Water Treatment Plant and Billing Report
Billing Period : August 23, 2016 thru September 23, 2016

Mth. & Yr.	Water		HPUD Offices/Parks	Difference Water	Sewer	Invoiced	Invoiced	Invoiced
	Gals. Produced	Gals. Invoiced	Gallons not Invoiced	Not accounted	Influent	Water	Sewer	Trash
Jul-15	38,541,000	27,999,153	748,100	9,793,747	18,391,000	\$ 126,237.41	\$ 98,850.73	\$ 39,890.54
Aug-15	41,282,000	29,542,948	1,594,840	11,739,052	17,517,000	\$ 127,873.59	\$ 99,260.15	\$ 40,714.90
Sep-15	41,935,000	31,632,737	1,166,260	9,136,003	19,303,000	\$ 131,788.83	\$ 99,236.82	\$ 40,793.96
Oct-15	35,704,000	24,287,593	1,038,820	10,377,587	18,747,000	\$ 118,097.94	\$ 99,439.87	\$ 40,833.70
Nov-15	32,894,000	24,569,670	860,910	7,463,420	20,848,000	\$ 120,775.90	\$ 99,350.96	\$ 40,678.04
Dec-15	27,594,000	18,779,872	572,160	8,241,968	20,764,000	\$ 112,142.95	\$ 99,298.66	\$ 40,650.65
Jan-16	26,070,000	15,494,455	648,430	9,927,115	21,262,000	\$ 108,298.08	\$ 99,279.08	\$ 40,529.25
Feb-16	28,092,000	18,993,526	936,501	8,161,973	21,207,000	\$ 111,685.78	\$ 99,344.04	\$ 40,906.15
Mar-16	29,337,000	20,528,514	1,089,340	7,719,146	19,714,000	\$ 113,688.03	\$ 99,371.11	\$ 41,241.58
Apr-16	31,271,000	23,401,831	1,680,289	6,188,880	18,802,000	\$ 116,015.76	\$ 99,363.69	\$ 41,245.88
May-16	36,109,000	27,065,618	1,620,061	7,423,321	18,720,000	\$ 122,812.76	\$ 99,166.96	\$ 41,293.08
Jun-16	41,043,000	30,977,538	1,357,648	8,707,814	18,210,000	\$ 132,309.92	\$ 99,182.40	\$ 41,286.89
Jul-16	46,754,000	32,671,154	1,683,264	12,399,582	17,574,000	\$ 136,461.10	\$ 98,798.49	\$ 41,132.20
Aug-16	43,487,000	37,639,673	2,245,622	3,601,705	17,427,000	\$ 131,341.94	\$ 98,999.03	\$ 41,241.49
Sep-16	40,587,000	30,081,634	1,257,491	9,247,875	18,403,000	\$ 131,264.57	\$ 99,491.68	\$ 41,394.45


Totals includes billing for final accounts

To the best of my knowledge, the information is true and correct.



 Liz German
 Office Senior Clerk

10/13/16
 Date


Water Produced by Month 2015-16

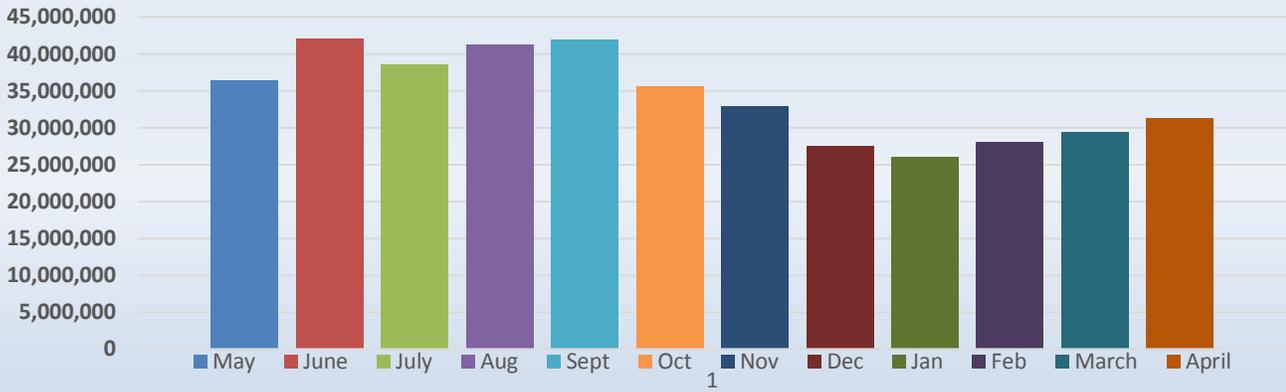


Sewer Influent by Month 2015-16

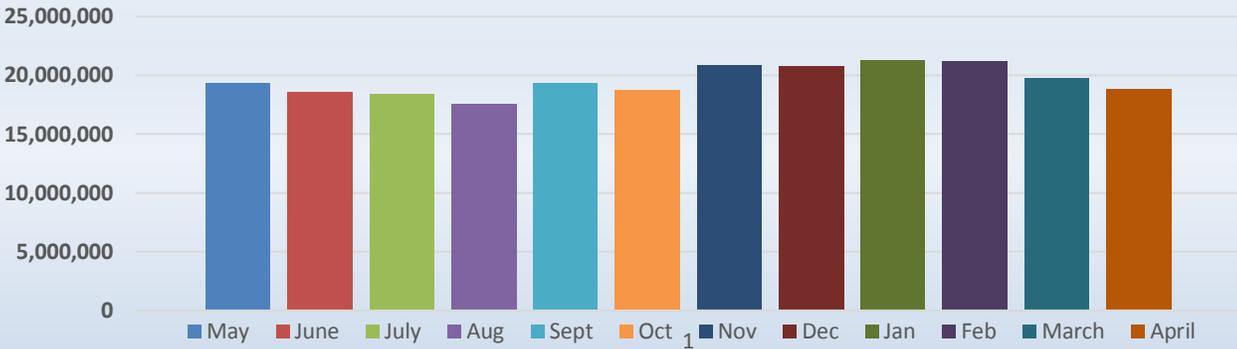

Water Production by Month Two Year Comparison

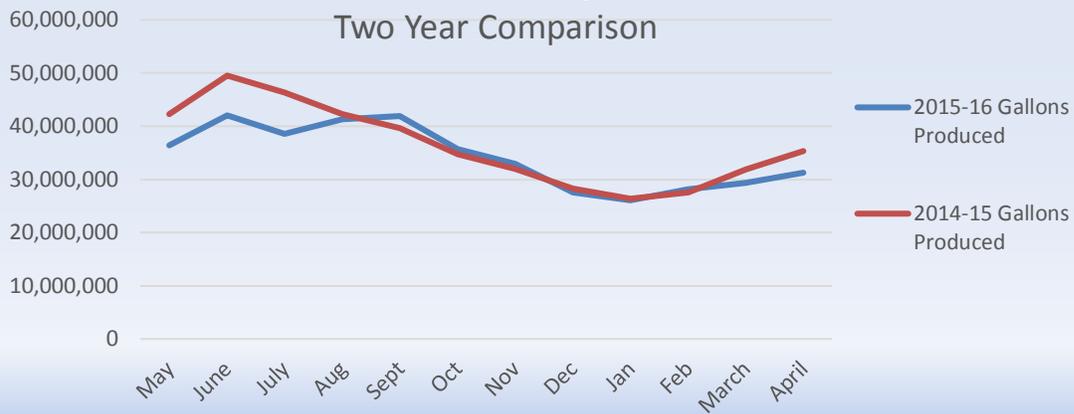



Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H
Heber, CA 92249
TEL. (760) 482-2440 • FAX (760) 353-9951
www.heber.ca.gov

October 12, 2016

Attention: Laura Fischer
General Manager

SUBJECT: Heber W.W.T.P. Operations from August 23, 2016 to
September 23, 2016

- A. Major violations: August 29, over limit of instantaneous maximum daily of 400 MPN/100 ml for E. Coli (2419) and Fecal Coliform (1600).
- B. Minor violations (NONE)
- C. Major sewer spills (NONE)
- D. Main sewer Plugs: (NONE)
- E. UV System: Operating fine. Checked it and clean after violation. Found no problems.
- F. Vactor Truck: Cleaned Regional Lift Station wetwell. Lots of paper towels, candy wrappers and grease.

- G. From August 23, 2016 through September 23, 2016:
Heber Wastewater Plant received and treated 18.403 MG.

- H. HPUD did not exceed the daily maximum flow (1.2 MGD) as
of September 23, 2016.

Sincerely,

A handwritten signature in blue ink that reads "Lucas G. Agatep".

Lucas G. Agatep
Wastewater Plant Lead Operator

Heber Public Utility District is an equal opportunity provider and employer