

Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H
Heber, CA 92249
TEL. (760) 482-2440 • FAX (760) 353-9951
www.heber.ca.gov

April 7, 2016

Attention: Mrs. Fischer

Subject: March 2016 Monthly Report

On the billing cycle ending on the 24th of March 29,337,000 gallons of water were used by our consumers, an average of 1,011,000 gallons was used per day.

On March 10, 2016 pond #1 was drained in order for the contractor (Pacific Hydrotec) to work on the construction of the static mixer which is part of the water treatment plant expansion project.

On March 21, 2016 the base of the blower broke causing air leaks in a few connections. The blower is used to agitate the media in the clarifier/filter units in a cleaning cycle. A temporary base was installed and two new bases have been ordered. There was no adverse effect to the water quality or violation because of this incident.


On March 29, 2016 our Chemical supplier (Brenntag) send one of their chemist to conduct some jar testing using a few chemicals that may lower the TTHM's and Haa5. We should have the complete results of the jar test by mid- April and by then make an informed decision on what chemical we should add to the raw water ponds.

If you have any questions, please contact me at (760) 427-4685

Respectfully,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez
Chief Operator
Heber Public Utility District



Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H
Heber, CA 92249
TEL. (760) 482-2440 • FAX (760) 353-9951
www.heber.ca.gov

April 7, 2016

Attention: Mrs. Fischer
General Manager

Subject: Water Distribution Report March 2016

- a) Water breaks (0)


- b) Service Leak (1)
 - 1. 78 E. 6th Street Space #14

- c) Work orders (80)

Respectfully,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez
Water Distribution Chief Operator
Heber Public Utility District



Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H
Heber, CA 92249
TEL. (760) 482-2440 • FAX (760) 353-9951
www.heber.ca.gov

April 13, 2016

Attention: Laura Fischer
General Manager

SUBJECT: Heber W.W.T.P. Operations from February 24, 2016 to
March 24, 2016

- A. Major violations (NONE)
- B. Minor violations (NONE)
- C. Major sewer spills (NONE)
- D. Main sewer Plugs: (NONE)
- E. UV System: Operating fine.
- F. Vactor Truck: Not used during this month.

- G. From February 24, 2016 through March 24, 2016:
Heber Wastewater Plant received and treated 19.714 MG.

- H. HPUD did not exceed the daily maximum flow (1.2 MGD) as
of March 24, 2016.


Sincerely,

A handwritten signature in blue ink that reads "Lucas G. Agatep".


Lucas G. Agatep
Wastewater Plant Lead Operator

Heber Public Utility District is an equal opportunity provider and employer

Water Produced by Month 2015-16

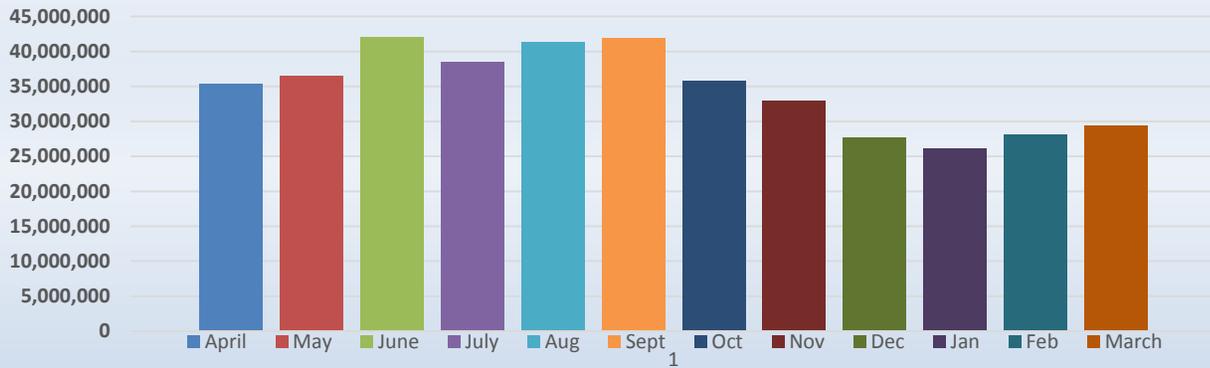

Sewer Influent by Month 2015-16

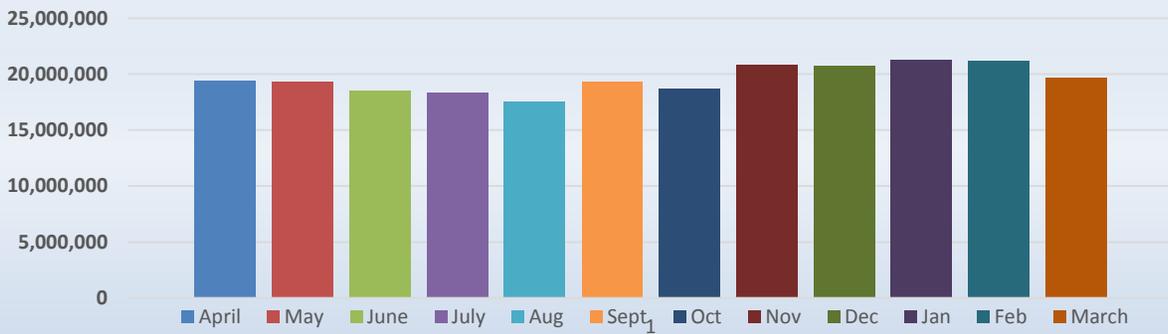

Water Production by Month Two Year Comparison

