

## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

December 10, 2015

Attention: Mrs. Fischer

Subject: November 2015 Monthly Report

On the billing cycles ending on the 25th of November 32,894,000 gallons of water were used by our consumers, an average of 1,028,000 gallons was used per day.

On November, 30, 2015 after removing the dry sludge, pond #1 was placed back in service. Upon inspection of pond #1 there were no visible damages. We are currently draining pond #2 to continue with our annual cleaning of the ponds.


There were no major issues in the water treatment plant for the month of November 2015.

If you have any questions, please contact me at (760) 427-4685

Sincerely,

A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H  
Heber, CA 92249  
TEL. (760) 482-2440 • FAX (760) 353-9951  
[www.heber.ca.gov](http://www.heber.ca.gov)

December 10, 2015

Attention: Mrs. Fischer  
General Manager

Subject: Water Distribution Report November 2015

A) Water breaks (3)

1. 1140 Valley Blvd.
2. 10 Mallard Ct.
3. Intersection of Pitzer Rd. and Meridian St.

B) Service Leak (1)

1. Children's Park 2 inch water service leak


C) Work orders ( 27 )

Sincerely,


A handwritten signature in blue ink, appearing to read "Francisco Rodriguez".

Francisco Rodriguez  
Chief Operator  
Heber Public Utility District


### Water Produced by Month 2014-15

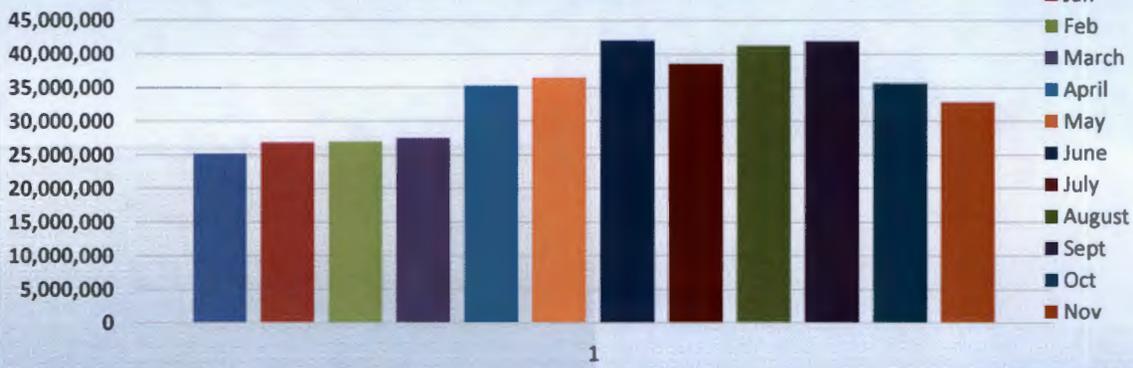

### Sewer Collection by Month 2014-15

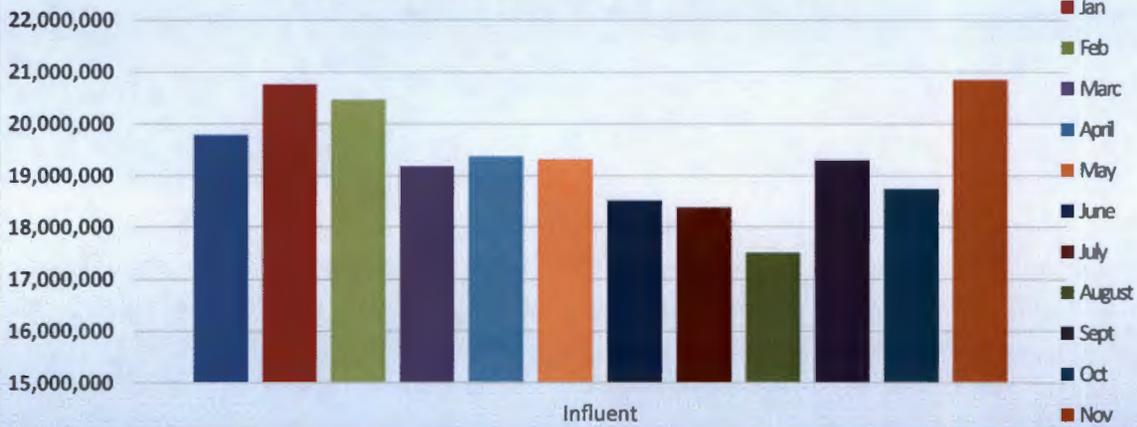

### Water Production by Month Two Year Comparison

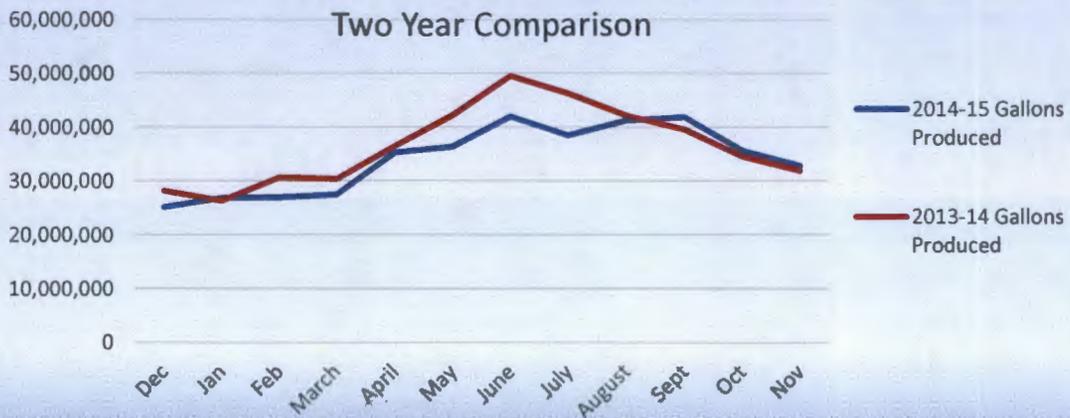




**HEBER PUBLIC UTILITY DISTRICT**  
**Water Treatment Plant and Billing Report**  
**Billing Period : October 25, 2015 thru November 25, 2015**


<i>Mth. &amp; Yr.</i>	<i>Water</i>		<i>HPUD Offices/Parks</i>	<i>Difference Water</i>	<i>Sewer</i>	<i>Invoiced</i>	<i>Invoiced</i>	<i>Invoiced</i>
	<i>Gals. Produced</i>	<i>Gals. Invoiced</i>	<i>Gallons not invoiced</i>	<i>Not accounted</i>	<i>Influent</i>	<i>Water</i>	<i>Sewer</i>	<i>Trash</i>
Sep-14	39,630,000	25,830,983	1,043,570	12,755,547	18,088,000	\$ 119,731.66	\$ 98,936.31	\$ 40,383.04
Oct-14	34,674,000	24,238,933	673,950	10,367,672	19,563,000	\$ 117,929.12	\$ 98,838.72	\$ 40,160.35
Nov-14	34,351,000	21,407,407	601,490	12,342,103	21,559,000	\$ 113,870.72	\$ 99,037.78	\$ 40,130.68
Dec-14	25,194,000	21,426,940	1,450,380	2,316,680	19,786,000	\$ 115,808.39	\$ 99,067.67	\$ 40,131.37
Jan-15	26,886,000	17,282,967	432,630	9,170,403	20,754,000	\$ 109,681.46	\$ 99,037.87	\$ 40,138.38
Feb-15	27,013,000	16,586,459	411,800	10,014,741	20,458,000	\$ 108,239.11	\$ 99,077.59	\$ 40,052.05
Mar-15	27,543,000	18,024,513	402,780	9,115,707	19,181,000	\$ 110,957.74	\$ 99,131.35	\$ 40,098.74
			high due to sewer plant					
Apr-15	35,351,000	33,459,294	10,188,590	1,891,706	19,371,000	\$ 119,590.57	\$ 99,077.40	\$ 40,060.27
May-15	36,450,000	25,680,055	933,970	9,835,975	19,316,000	\$ 121,795.38	\$ 98,988.32	\$ 40,008.93
Jun-15	42,038,000	28,045,986	938,970	13,053,044	18,520,000	\$ 127,203.74	\$ 98,986.67	\$ 40,101.70
Jul-15	38,541,000	27,999,153	748,100	9,793,747	18,391,000	\$ 126,237.41	\$ 98,850.73	\$ 39,890.54
Aug-15	41,282,000	29,542,948	1,594,840	11,739,052	17,517,000	\$ 127,873.59	\$ 99,260.15	\$ 40,714.90
Sep-15	41,935,000	31,632,737	1,166,260	9,136,003	19,303,000	\$ 131,788.83	\$ 99,236.82	\$ 40,793.96
Oct-15	35,704,000	24,287,593	1,038,820	10,377,587	18,747,000	\$ 118,097.94	\$ 99,439.87	\$ 40,833.70
<b>Nov-15</b>	<b><u>32,894,000</u></b>	<b><u>24,569,670</u></b>	<b><u>860,910</u></b>	<b><u>7,463,420</u></b>	<b><u>20,848,000</u></b>	<b><u>\$ 120,775.90</u></b>	<b><u>\$ 99,350.96</u></b>	<b><u>\$ 40,678.04</u></b>

Totals includes billing for final accounts

To the best of my knowledge, the information is true and correct.

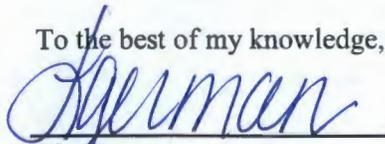  
 Liz German  
 Office Senior Clerk

12/10/15  
 Date



## Heber Public Utility District

1078 Dogwood Rd., Suite 103 • P. O. Box H

Heber, CA 92249

TEL. (760) 482-2440 • FAX (760) 353-9951

[www.heber.ca.gov](http://www.heber.ca.gov)

December 8, 2015

Attention: Laura Fischer  
General Manager

SUBJECT: Heber W.W.T.P. Operations from October 25, 2015 to  
November 25, 2015

- A. Major violations (NONE)
- B. Minor violations (NONE)
- C. Major sewer spills (NONE)
- D. Main sewer Plugs: (NONE)
- E. UV System: Operating fine.
  
- F. From October 25, 2015 through November 25, 2015:  
Heber Wastewater Plant received and treated 20.848 MG.
  
- G. HPUD did not exceed the daily maximum flow (1.2 MGD) as  
of November 25, 2015.

Sincerely,

A handwritten signature in blue ink that reads "Lucas G. Agatep".

Lucas G. Agatep  
Wastewater Plant Lead Operator